




BATAAN PENINSULA STATE UNIVERSITY
City of Balanga 2100 Bataan
Philippines
PHYSICAL PLANT AND ENGINEERING SERVICES

BID BULLETIN

**SUPPLY AND INSTALLATION OF FIRE DETECTION ALARM SYSTEM FOR COLLEGE OF NURSING (CNM) AND
ADMINISTRATION BUILDING AT BPSU MAIN CAMPUS**


- 1. Use EMT for all exposed conduits
- 2. Supply and Installation of 1 FACP for each building (see attached revised plans)

ADMIN BUILDING:

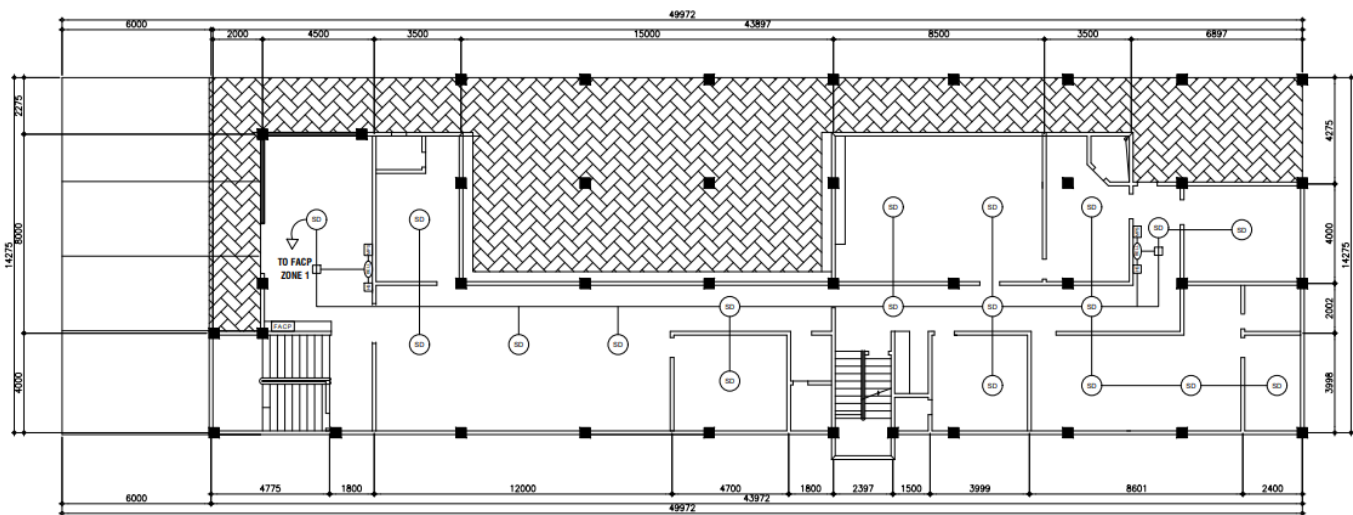

GROUND FLOOR PLAN
SMOKE DETECTOR LAYOUT PLAN
SCALE : 1:100 MTS.

CNM BUILDING:

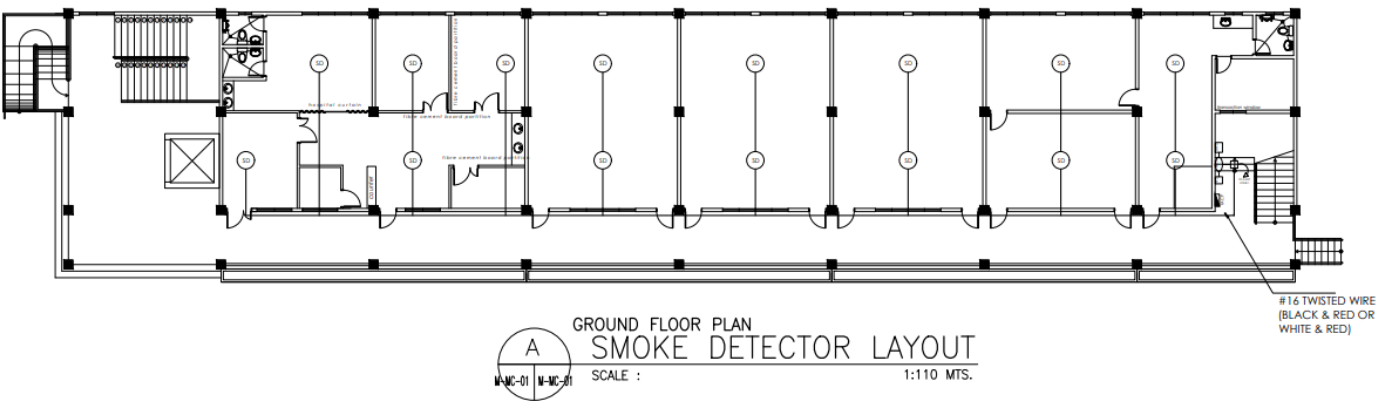

Prepared by:

Ar. Roxette S. Umerez, uap
Head, TWG for Infrastructure

Noted by:

Dr. Alfredo D. Valentos, PME
PPES Director